

H5000 Woltmanův vodoměr na studenou vodu


Specifikace produktu



Technická data

Standardní označení	Jmenovitý průtok	jednotky	DN40	DN50	DN65	DN80 malý průtok	DN80	DN100	DN125	DN150	
	Q4	m3/h	50	79	79	79	200	200	200	200	
	Q3	m3/h	40	63	63	63	160	160	160	160	
	Q2	m3/h	0.13	0.13	0.13	0.13	0.32	0.32	0.32	0.32	
	Q1	m3/h	0.08	0.08	0.08	0.08	0.2	0.2	0.2	0.2	
Q3/Q1	Ratio R	500	800	800	800	800	800	800	800	800	
Rozšířená verze	Q4	m3/h	50	79	79	79	200	200	200	200	
	Q3	m3/h	40	63	63	63	160	160	160	160	
	Q2	m3/h	0.08	0.08	0.08	0.08	0.2	0.2	0.2	0.2	
	Q1	m3/h	0.05	0.05	0.05	0.05	0.13	0.13	0.13	0.13	
	Q3/Q1	Ratio R	800	1250	1250	1250	1250	1250	1250	1250	1250
MID ověření	Q2	m3/h	0.06	0.06	0.06	0.06	0.13	0.13	0.13	0.13	
	Q1	m3/h	0.04	0.04	0.04	0.04	0.08	0.08	0.08	0.08	
	Q3/Q1	Ratio R	1000	1600	1600	1600	2000	2000	2000	2000	
	$\Delta P @ Q3$	Bar	0.3	0.37	0.31	0.33	0.3	0.35	0.4	0.4	
	Working P max	Bar	16								
	Start Flow	m3/h	0.02	0.02	0.02	0.02	0.05	0.05	0.05	0.05	

Porovnání rozsahu měření (DN50)

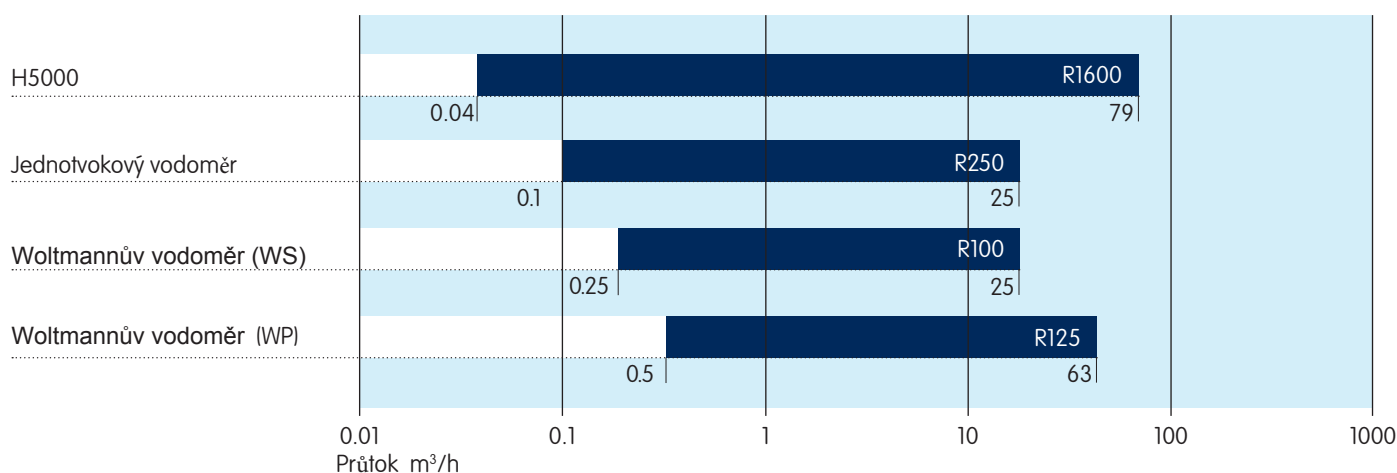

**FRANTIŠEK
POKORNÝ**
měřicí technika

Čechova 1431
290 01 Poděbrady
Tel.: +420 602 374 670
Fax.: +420 325 614 430
Email: info@pokorny-vodomery.cz
Web: www.pokorny-vodomery.cz



elster
Vital Connections